


- 1 = PORT 1-1
2 = PORT 1-2
3 = PORT 2-1
4 = PORT 2-2
5 = PORT 3-1
6 = PORT 3-2
7 = PORT 4-1
8 = PORT 4-2
9 = N/C
10 = N/C
11 = SHIELD
12 = GROUND






- 1 = BLUE (V-)
2 = BROWN (V+)
3 = DRAIN (SHD)
4 = GREEN/YELLOW (GND)




HOUSING MATERIAL
HOUSING FINISH/COLOR
RECEPTACLE HOUSING MATERIAL/FINISH
CONTACT CARRIERS/COLOR (J1-J4)
CONTACT CARRIER/COLOR (P1)

- | |
|---|
| DIE-CAST ALUMINUM ALLOY |
| POWDER COAT/BLACK |
| STAINLESS STEEL/PASSIVATED |
| TPU/BLACK |
| NYLON or PBT/WHITE |
| BRASS/GOLD |
| 250 VAC/300 VDC |
| 4.0 AMPS PER PORT, 8.0 AMPS TOTAL |
| IP 67 - ONLY WHEN ALL RECEPTACLES ARE COVERED WITH PLUGS OR CONNECTED |
| -40°C to +80°C (-40°F to +176°F) |

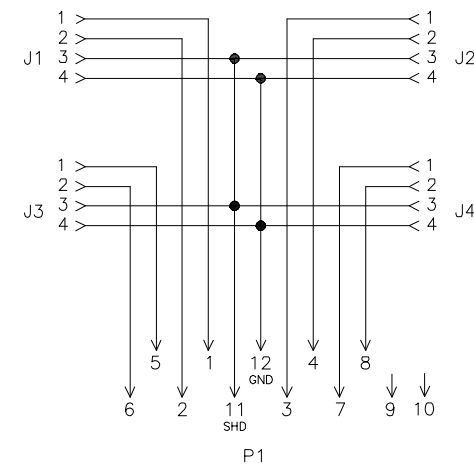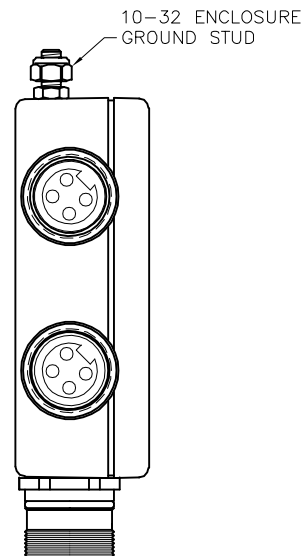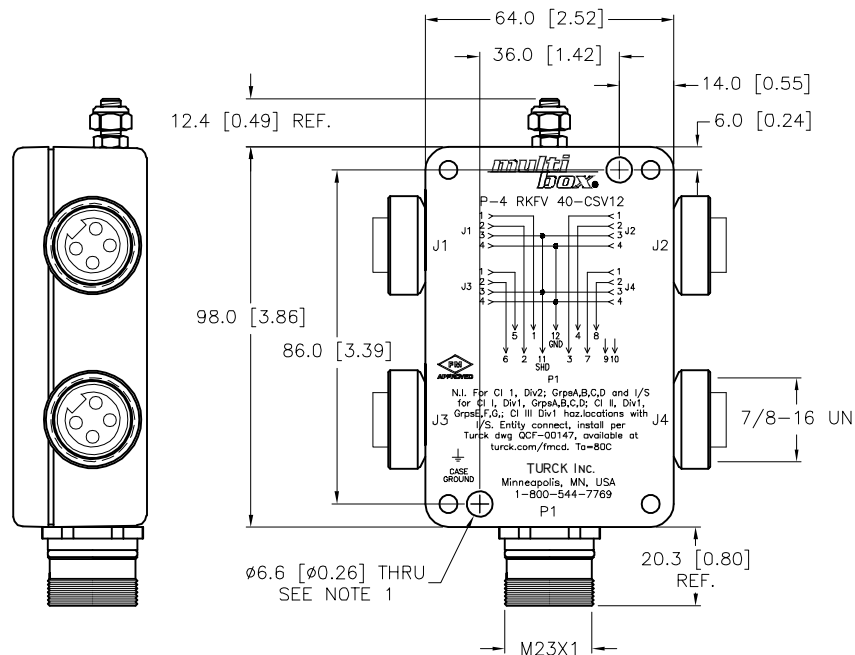

WIRING DIAGRAM

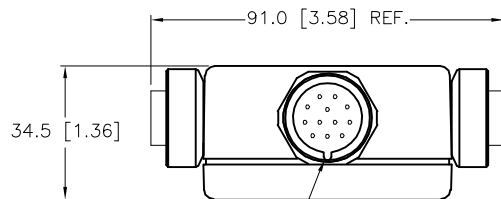

KEYWAY CAN BE AT ANY POSITION

NOTES:


1. CLEARANCE HOLE FOR (2X) 1/4-20 MOUNTING SCREWS. (NOT INCLUDED)

F	UPDATE TEMPERATURE RATING
---	---------------------------

NF	03/26/19	68987
----	----------	-------

BY	DATE	ECO NO.
----	------	---------

RELATED DOCUMENTS
1.
2.
3.
4.

3RD ANGLE
PROJECTION

THIS DRAWING IS
CONFIDENTIAL AND THE
PROPERTY OF TURCK
INC. USE OF THIS
DOCUMENT WITHOUT
WRITTEN PERMISSION IS
PROHIBITED.

DRFT	DD
APVD	

APVD	
------	--

UNIT OF MEASUREMENT
MILLIMETER [INCH]

DO NOT SCALE THIS DRAWING

TURCK 3000 CAMPUS DRIVE
MINNEAPOLIS, MN 55441
1-800-544-7769
(763) 553-7300
(763) 553-0708 fax
www.turck.us

/03	DESCRIPTION
0	P-4 RKFV 40-CSV12

IDENTIFICATION NO.	REV
U0945-31	F

FILE: U0945-31	SHEET 1 OF 1
----------------	--------------