






MALE END VIEW (P1)	FEMALE END VIEW (J1,J2)	FEMALE END VIEW (J3)	SPECIFICATIONS	
 1 = PORT 1-1 2 = PORT 1-2 3 = PORT 2-1 4 = PORT 2-2 5 = PORT 3-1 6 = PORT 3-2 7 = DRAIN 8 = GROUND 9 = PORT 3-4 10 = PORT 3-5	 1 = V- 2 = V+ 3 = SHLD 4 = GND	 1 = V- 2 = V+ 3 = GND 4 = V- 5 = V+ 6 = SHLD	HOUSING MATERIAL	DIE-CAST ALUMINUM ALLOY
			HOUSING FINISH/COLOR	POWDER COAT/BLACK
			RECEPTACLE HOUSINGS	STAINLESS STEEL/PASSIVATED
			CONTACT CARRIERS	TPU
			CONTACTS	BRASS/GOLD
			OPERATING VOLTAGE	300 V
			OPERATING CURRENT	7.0 AMPS PER PORT
			PROTECTION CLASS to DIN 40050	IP 67 - ONLY WHEN ALL RECEPTACLES ARE COVERED WITH PLUGS OR CONNECTED
			OPERATING TEMPERATURE	-40°C to +80°C (-40°F to +176°F)
			  	

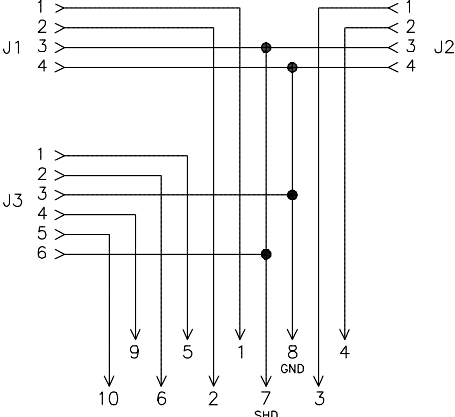

P1

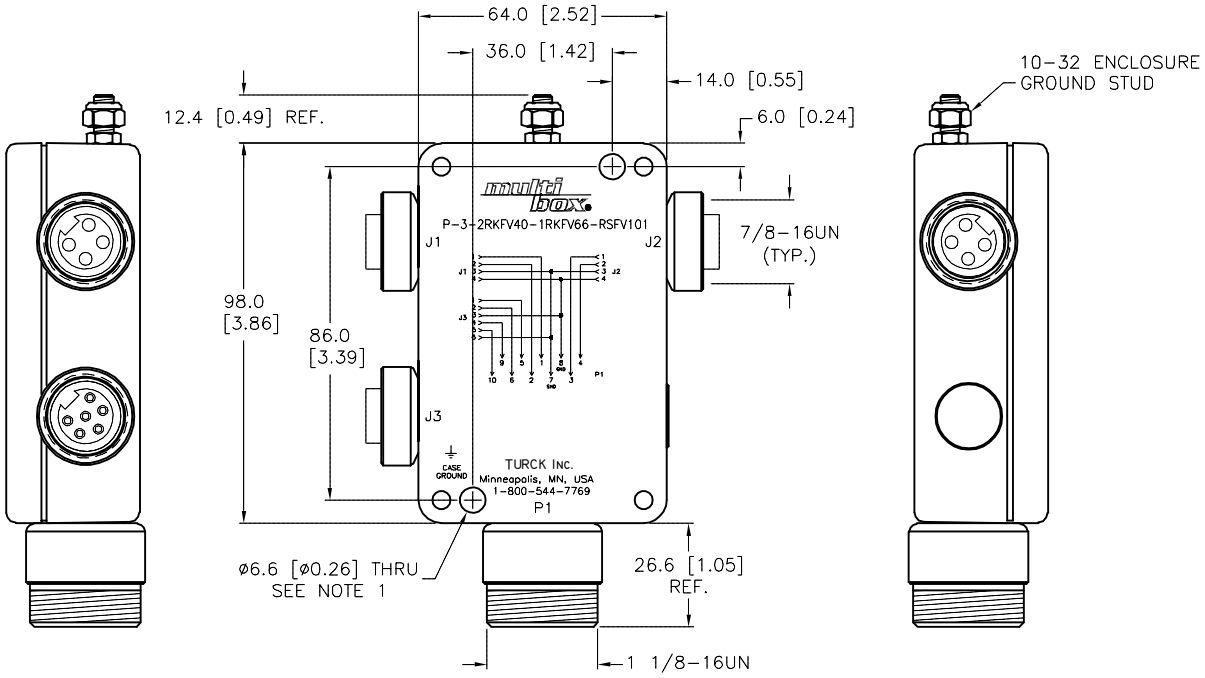

NOTES:

1. CLEARANCE HOLE FOR 1/4-20 MOUNTING SCREWS (2 NOT INCLUDED).

KEYWAY CAN BE AT ANY POSITON

RELATED DOCUMENTS

- 1.
- 2.
- 3.
- 4.


MATERIAL

SEE SPECIFICATIONS

FINISH

SEE SPECIFICATIONS

3RD ANGLE PROJECTION



ALL DIMENSIONS DISPLAYED ON THIS DRAWING ARE FOR REFERENCE ONLY

CONTACT TURCK FOR MORE INFORMATION

THIS DRAWING IS CONFIDENTIAL AND THE PROPERTY OF TURCK INC. USE OF THIS DOCUMENT WITHOUT WRITTEN PERMISSION IS PROHIBITED.

DRFT KMY

APVD C.K.

DATE 06/12/14

SCALE 1=2.0

UNIT OF MEASUREMENT

MILLIMETER [INCH]

DO NOT SCALE THIS DRAWING

3000 CAMPUS DRIVE
MINNEAPOLIS, MN 55441
1-800-544-7769
(763) 553-7300
(763) 553-0708 fax
www.turck.us

TURCK

DESCRIPTION

P-3-2RK4V40-1RK4V66-RSFV101

IDENTIFICATION NO.

U2-23994

REV

B

FILE: U2-23994

SHEET 1 OF 1